

Tipo materiale		Cond.	C.Spec.	Massa vol.	$\delta \cdot 10^{-12}$	Spess.
STRATIGRAFIA		(W/m°C)	(J/kg°C)	(kg/m³)	(kg/msPa)	(cm)
1	Intonaco a base cementizia (interno)	0.700	1010	1400.0	18.00000	1.50
2	Alv. 25 inc. V/50 SS	0.159	840	800.0	21.00000	25.00
3	Isolante (EPS)	0.031	1340	20.0	4.00000	6.00
4	Intonaco a base cementizia	0.700	1010	1400.0	18.00000	1.50


**VALORI IN REGIME STAZIONARIO**

Massa frontale	243.20	kg/m²		
Conduttanza	0.28	W/m²°C	0.24	kCal/m²h°C
Resistenza termica	3.55	m²°C/W	4.13	m²h°C/kCal
Trasmittanza	0.27	W/m²°C	0.23	kCal/m²h°C

**48 dB POTERE FONOISOLANTE  $R_w$**

**VALORI IN REGIME VARIABILE (periodo 24 ore)**

Fattore attenuazione (modulo/fase)	0.11	adim
SFASAMENTO	13.34	ore

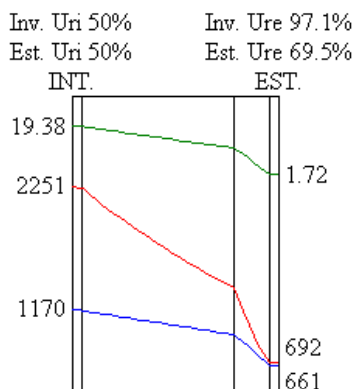

**LA STRUTTURA NON FORMA CONDENSA**